


Operation of the electricity and district heating sectors in a winter week\* in the T45-Electricity scenario

Figure 36

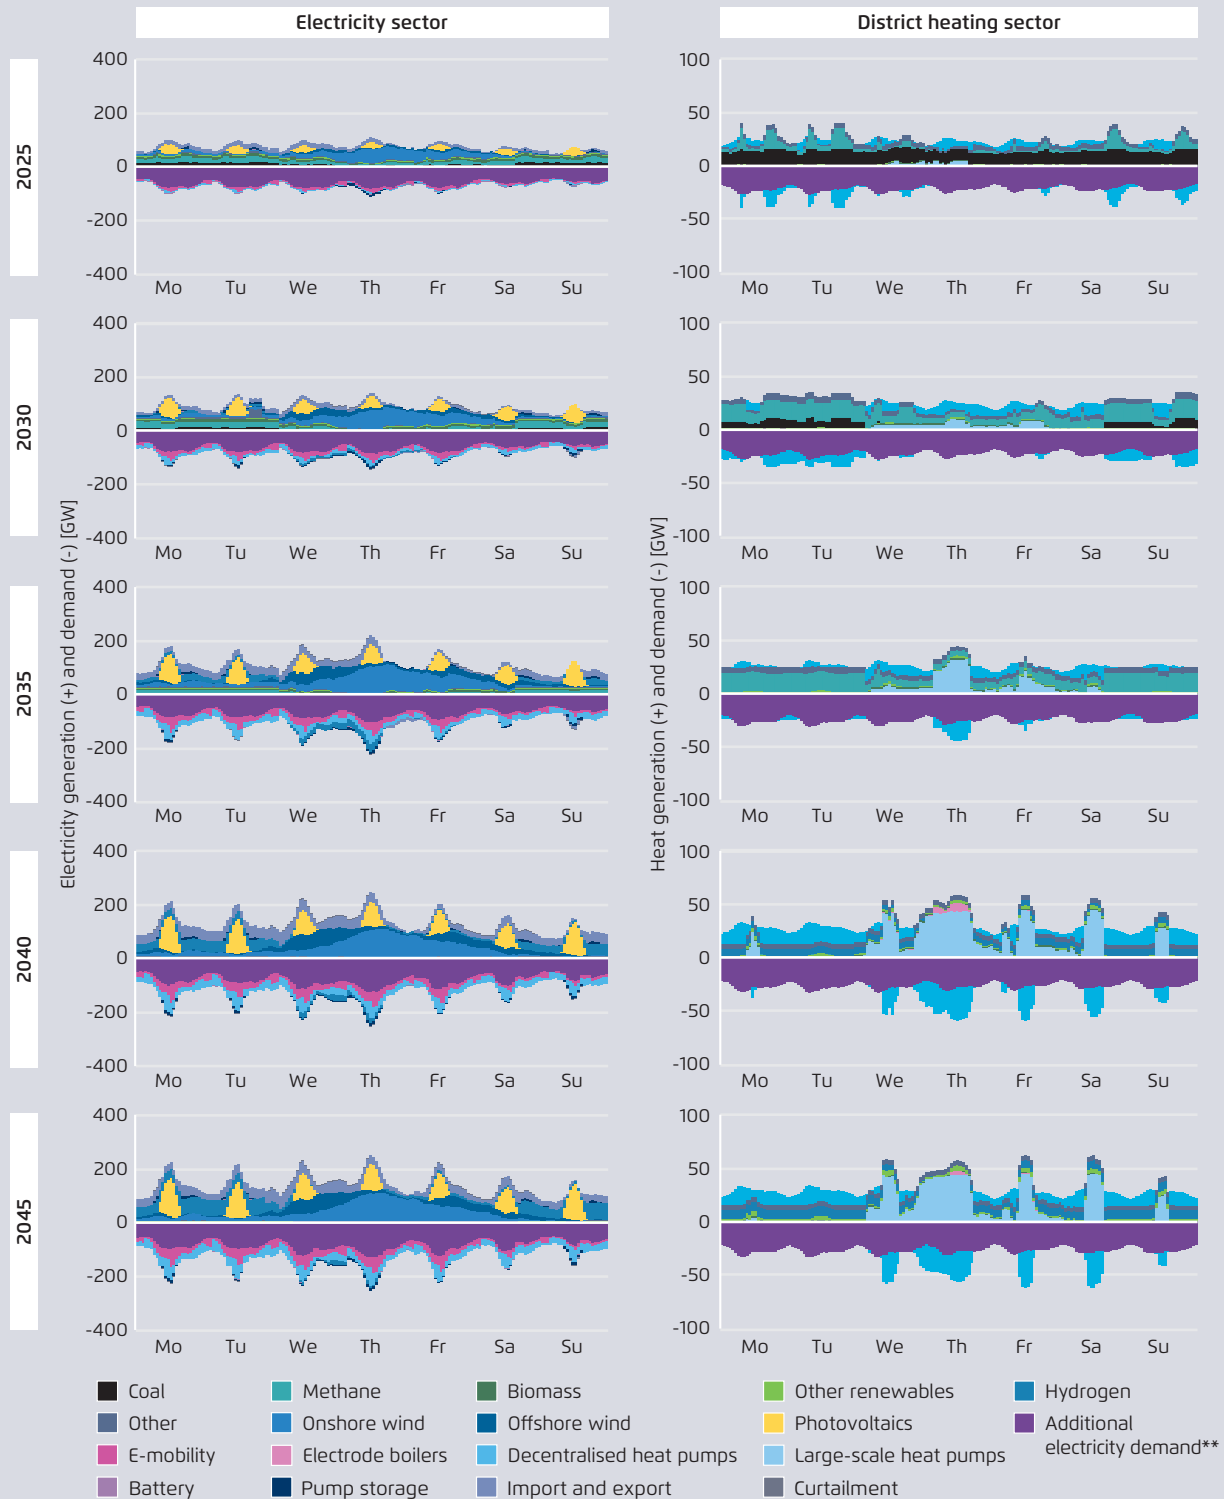

Fraunhofer IEG based on Fraunhofer ISI et al. (2022b). \* Early February \*\* incl. electricity demand from large-scale heat pumps